



EXAMPLE OF FACTORY  
SETTING FOR NOMINAL  
VOLTAGE CONNECTION

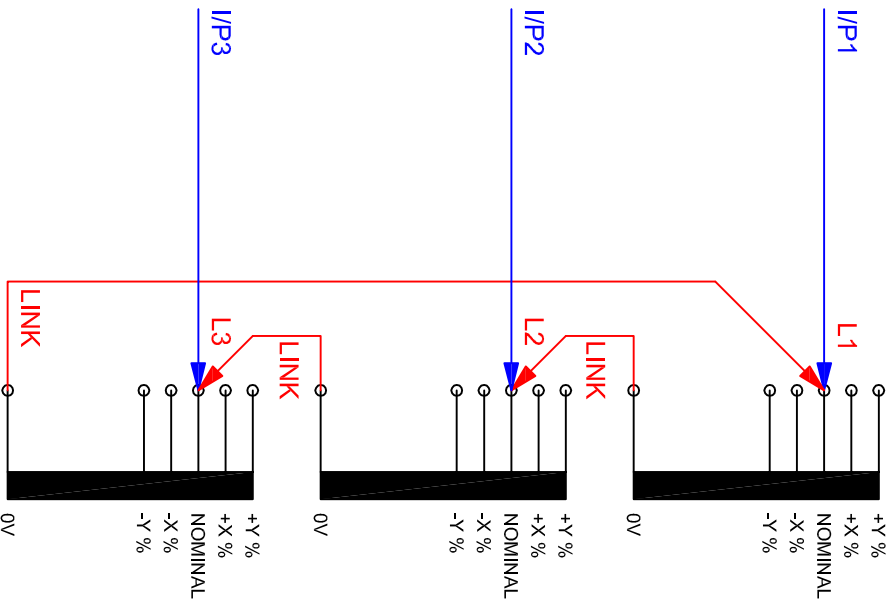


TO CONVERT TO ANOTHER  
TAP BOTH I/P LEAD AND  
DELTA CONNECTION LEADS  
MUST BE MOVED

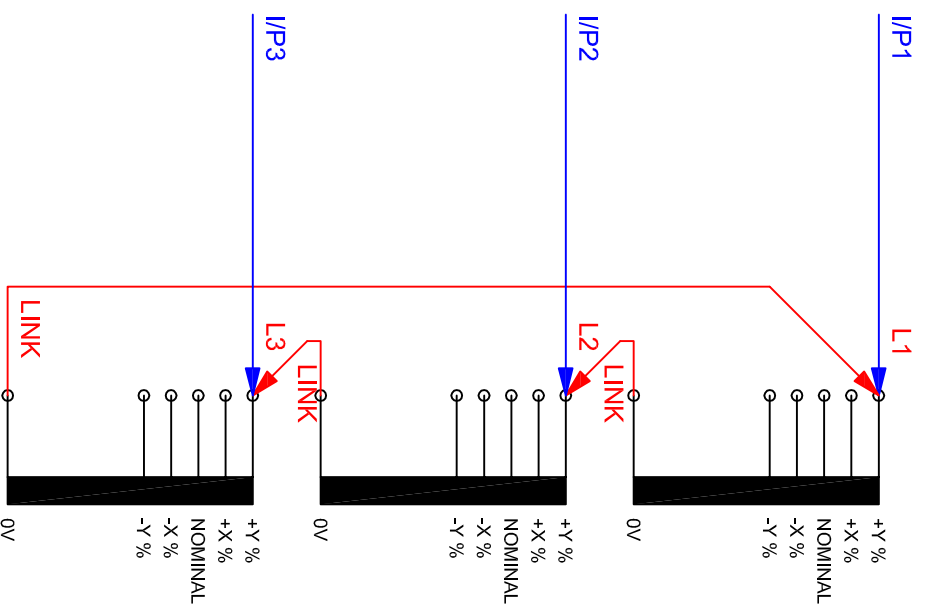

CORRECT CONNECTION

INCORRECT ADJUSTMENT:  
I/P LEADS AND DELTA  
CONNECTION LEADS NOT ON  
SAME TERMINAL

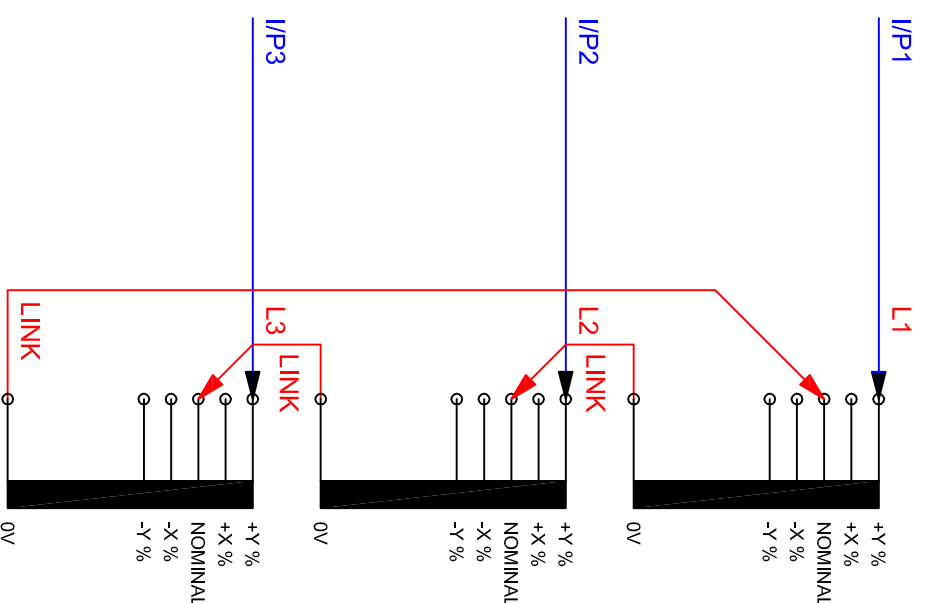

INCORRECT CONNECTION

REV				<b>CARROLL &amp; MEYNELL</b> TRANSFORMERS LIMITED TEL: 01642 617406 FAX: 01642 614178 enquiries@carroll-meynell.com	TITLE	3 PHASE DELTA TAP CONNECTION DIAGRAM ALL DIMENSIONS IN mm	DRAWN	PROJECTION	DATE	SCALE
4			GB		1/2/08		NTS			
3										
2										
1				5085	0	1/1				